



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)  
BOARD AND CODE ADMINISTRATION DIVISION

## NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY, FLORIDA  
PRODUCT CONTROL SECTION  
11805 SW 26 Street, Room 208  
T (786) 315-2590 F (786) 315-2599  
[www.miamidade.gov/economy](http://www.miamidade.gov/economy)

Continental Glass Systems, Inc.

325 West 74 Place  
Hialeah, FL 33014

### SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

### DESCRIPTION: Series "2000" Aluminum Sliding Glass Door – L.M.I.

**APPROVAL DOCUMENT:** Drawing No. CGS009, titled "Series 2000 Alum. Sliding Glass Door", sheets 1 through 07 of 07, dated 02/15/10, prepared by Building Drops, Inc., with the latest revision dated 07/25/12, signed and sealed by Hermes F. Norero, P. E., bearing the Miami-Dade County Product Control Section Revision Stamp with the Notice of Acceptance Number and Expiration Date by the Miami-Dade County Product Control Section.

### MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA No. 10-0520.05 and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by Jaime D. Gascon, P. E.



*Jaime D. Gascon*  
*11/23/12*

NOA No. 12-0824.08  
Expiration Date: September 22, 2015  
Approval Date: December 06, 2012  
Page 1

Continental Glass Systems, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.  
*(Submitted under previous NOA No. 10-0520.05)*
2. Drawing No. CGS009, titled "Series 2000 Alum. Sliding Glass Door", sheets 1 through 07 of 07, dated 02/15/10, prepared by Building Drops, Inc., with the latest revision dated 07/25/12, signed and sealed by Hermes F. Norero, P. E.

**B. TESTS**

1. Test reports on:
  - 1) Air Infiltration Test, per FBC, TAS 202-94
  - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
  - 3) Water Resistance Test, per FBC, TAS 202-94
  - 4) Large Missile Impact Test per FBC, TAS 201-94
  - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
  - 6) Forced Entry Test, per FBC 2411.3.2.1, and TAS 202-94
  - 7) Standard Test Methods for Deglazing Force of Fenestration Products per ASTM E 842-04
  - 8) Standard Test Method for Determination of Operating Force B of Sliding Windows and Doors per ASTM E 2068-00 (2008)along with marked-up drawings and installation diagram of Al. SDG, prepared by Fenestration Testing Laboratory, Inc., Test Report No. FTL-6122, dated 01/06/10, signed and sealed by Michael R. Wenzel, P. E.  
*(Submitted under previous NOA No. 10-0520.05)*

**C. CALCULATIONS**

1. Anchor verification calculations and structural analysis, complying with FBC-2010, prepared by Building Drops, Inc., dated 08/21/12, with the latest revision dated 11/15/12, signed and sealed by Hermes F. Norero, P. E.
2. Glazing complies with ASTM E1300-04

**D. QUALITY ASSURANCE**

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. 11-0624.01 issued to E.I. DuPont DeNemours & Co., Inc. for their "DuPont Butacite® PVB Interlayer" dated 09/08/11, expiring on 12/11/16.



Jaime D. Gascon, P. E.  
Product Control Section Supervisor  
NOA No. 12-0824.08  
Expiration Date: September 22, 2015  
Approval Date: December 06, 2012

Continental Glass Systems, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

**F. STATEMENTS**

1. Statement letter of no financial interest, conformance and complying with FBC-2010, issued by Building Drops, Inc., dated 08/21/12, signed and sealed by Hermes F. Norero, P. E.
2. Proposal issued by Product Control, dated 11/19/09, signed by Manuel Perez, P. E.  
*(Submitted under previous NOA No. 10-0520.05)*
3. Laboratory compliance letter for Test Report No. FTL-6122, issued by Fenestration Testing Laboratory, Inc., dated 01/06/10, signed and sealed by Michael R. Wenzel, P. E.  
*(Submitted under previous NOA No. 10-0520.05)*

**G. OTHERS**

1. Notice of Acceptance No. 10-0520.05, issued to Continental Glass Systems, Inc. for their Series "2000 Aluminum Sliding Glass Door - L.M.I.", approved on 09/22/10 and expiring on 09/22/15.



---

Jaime D. Gascon, P. E.  
Product Control Section Supervisor  
NOA No. 12-0824.08  
Expiration Date: September 22, 2015  
Approval Date: December 06, 2012

# CONTINENTAL GLASS SYSTEMS

## SERIES 2000 SLIDING GLASS DOOR

### (IMPACT)

#### INSTALLATION NOTES:

- TWO (2) INSTALLATION ANCHORS ON HEAD AND ONE (1) INSTALLATION ANCHOR ON SILL FOR EACH ANCHOR LOCATION SHOWN.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF  $\pm 1/2$  INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- FOR INSTALLATION DIRECTLY INTO CONCRETE/MASONRY, USE 5/16 INCH DIAMETER ITW TAPCONS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/4 INCH MINIMUM EMBEDMENT.
- FOR INSTALLATION DIRECTLY INTO WOOD FRAME, USE #14 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT.
- FOR INSTALLATION DIRECTLY INTO STEEL FRAME, USE 1/4" DIAMETER GRADE 5 TEK SELECT SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM PENETRATION BEYOND STEEL FRAME SUBSTRATE.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
  - WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
  - CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.
  - GROUT-FILLED CMU - UNIT STRENGTH CONFORMS TO ASTM C-90 WITH MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI AND GROUT CONFORMS TO ASTM C 476, MINIMUM GROUT COMPRESSIVE STRENGTH OF 2000 PSI.
  - HOLLOW BLOCK CMU - UNIT STRENGTH CONFORMS TO ASTM C-90 WITH MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI.
  - STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM 20 GA. (0.0346") WALL THICKNESS.

#### GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE 2010 FLORIDA BUILDING CODE (FBC), INCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
  - TAS 201-94
  - TAS 202-94
  - TAS 203-94
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, STEEL, AND 2X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT IN NON-HVHZ AREAS. IN HVHZ AREAS, ONE TIME PRODUCT APPROVAL TO BE OBTAINED FROM MIAMI-DADE PERA.
- APPROVED IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- WINDOW FRAME MATERIAL: ALUMINUM 6005-T5
- IN ACCORDANCE WITH THE 2010 FBC SEC. 2003.8.4 DISSIMILAR METALS INCLUDING FASTENERS THAT MAY COME INTO CONTACT WITH ALUMINUM UNIT FRAMING SHALL BE PROTECTED AS DEFINED IN SEC 2003.8.4.2.
- GLASS MEETS THE REQUIREMENTS OF ASTM E 1300-04 GLASS CHARTS. SEE SHEET 4 FOR GLAZING DETAIL.

#### TABLE OF CONTENTS

SHEET	REVISION	SHEET DESCRIPTION
1	A	INSTALLATION & GENERAL NOTES
2	A	ELEVATIONS & ANCHOR LAYOUTS
3	A	VERTICAL SECTIONS
4	A	HORIZONTAL SECTIONS & GLAZING DETAIL
5	A	COMPONENTS & BILL OF MATERIALS
6	A	COMPONENTS
7	A	CORNER ASSEMBLY

#### DESIGN PRESSURE RATING

DESIGN PRESSURE - ALL SIZES	MISSILE IMPACT RATING
+/-140.0 PSF	LARGE & SMALL MISSILE IMPACT RATED



325 W. 74TH PLACE  
HIALEAH, FL 33014  
PH: (305) 231-1101 FX: (305) 231-1103

TITLE: SERIES 2000 ALUM.  
SLIDING GLASS DOOR  
INSTALLATION  
& GENERAL NOTES

PREPARED BY:  
BUILDING DROPS, INC.  
398 E. DANIA BEACH BLVD. #338  
DANIA BEACH, FL 33004  
PH: 954.399.8478 FX: 954.744.4738


#### REVISIONS

NO.	DESCRIPTION	BY	DATE
A	FBC 2010 CODE CHANGE	JLA	07.25.12


HEPAGES F. NORERO, P.E.  
FLORIDA P. E. NO. 73778  
398 EAST DANIA BEACH BLVD. #338  
DANIA BEACH, FL 33004  
FBC CERT. OF AUTHORIZATION NO. 29578

PRODUCT REVISED  
is complying with the Florida  
Building Code  
Acceptance No. 12-0824-08  
Expiration Date 09/22/2015  
By: [Signature]  
Miami Dade Product Control


DATE: 07.25.12  
DWN BY: JLA  
CHK BY: HFN  
SCALE: NTS  
DWG #: CGS009  
SHEET: 1 OF 7

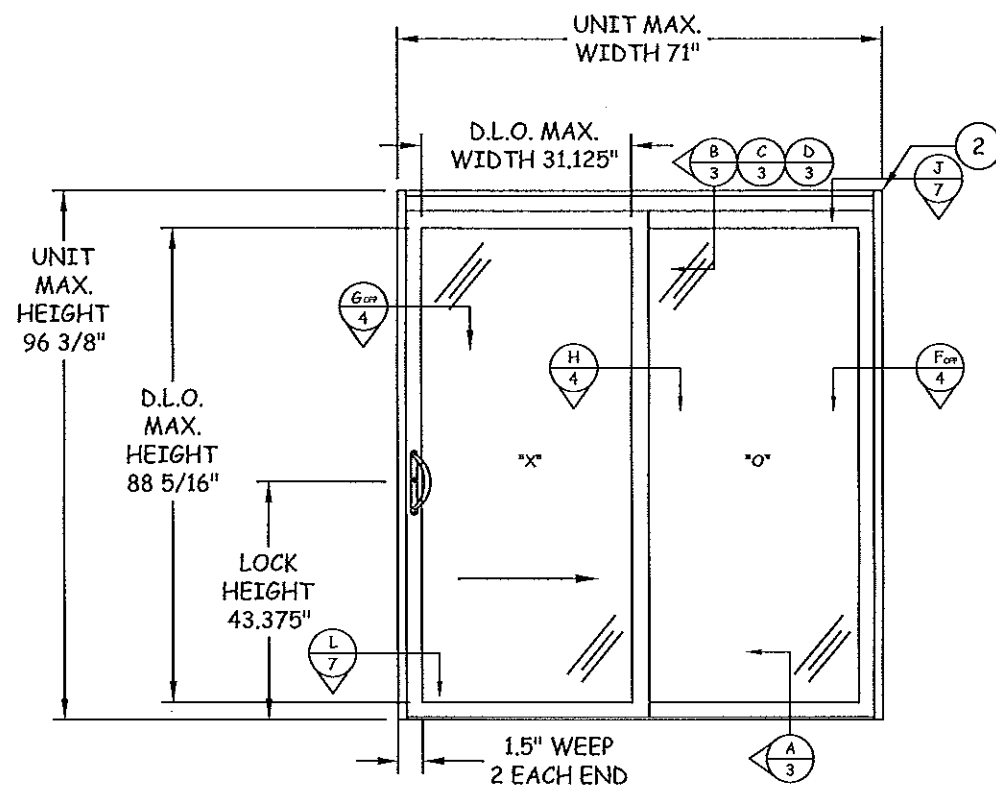


## ELEVATIONS

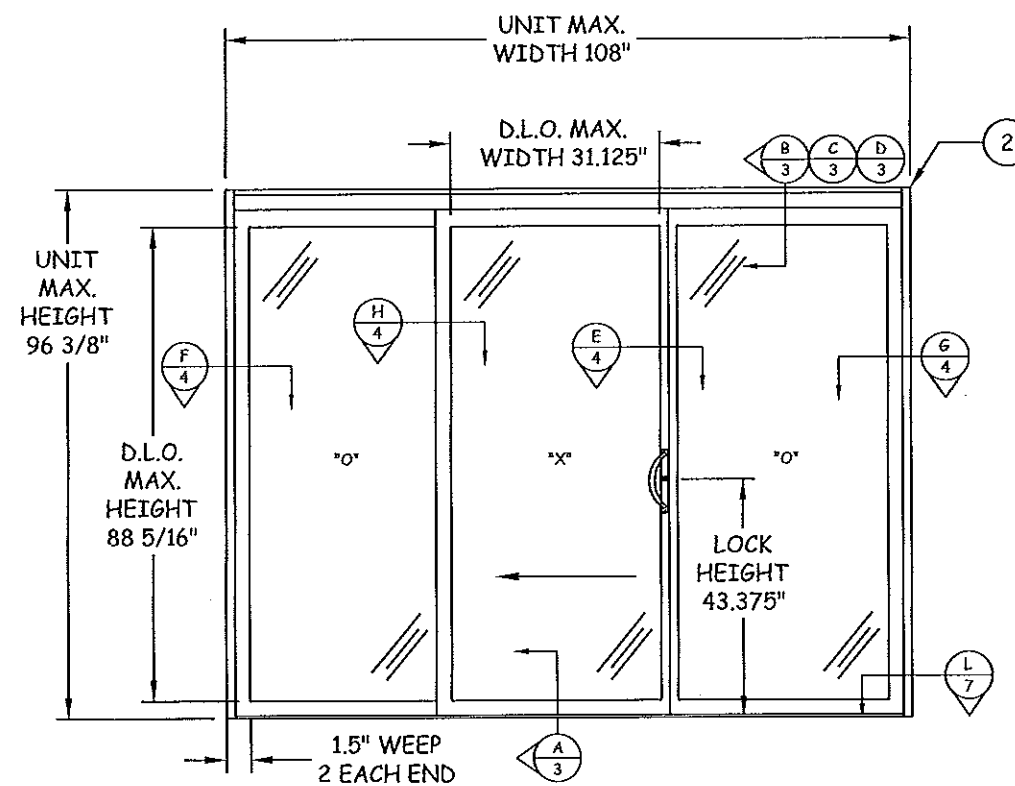


### HEAD RECEPTOR:

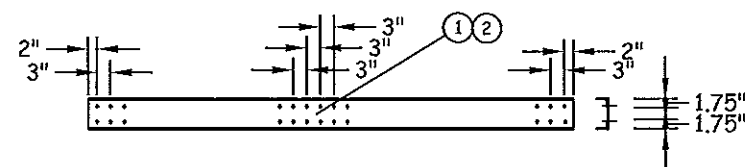


### HEAD RECEPTOR:

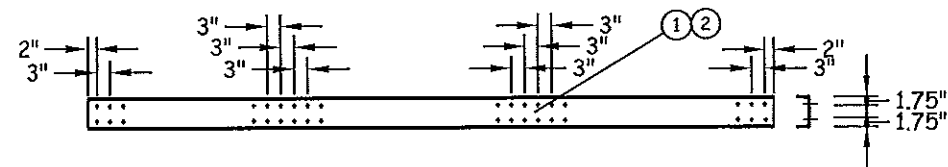

**STANDARD FRAME:**

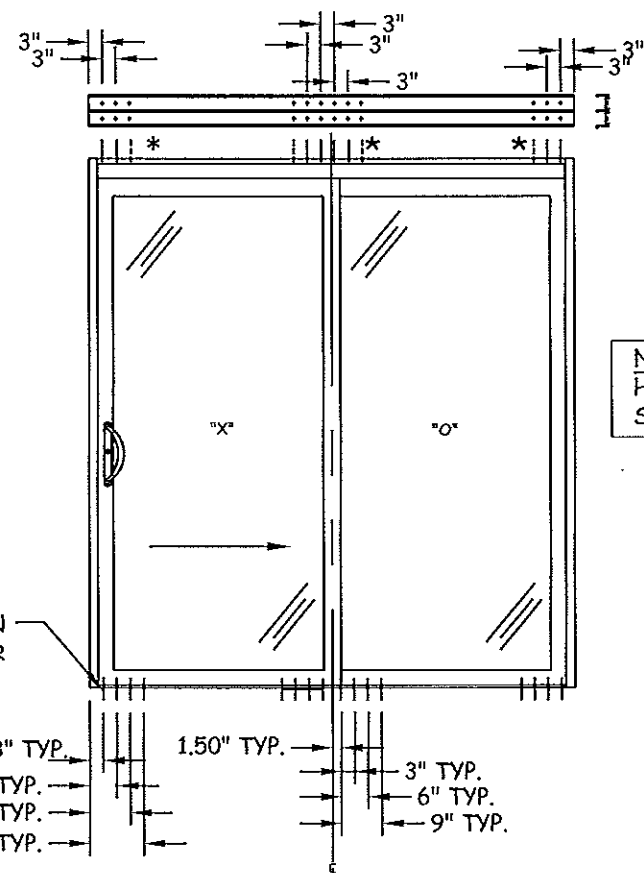

## ANCHOR LAYOUTS

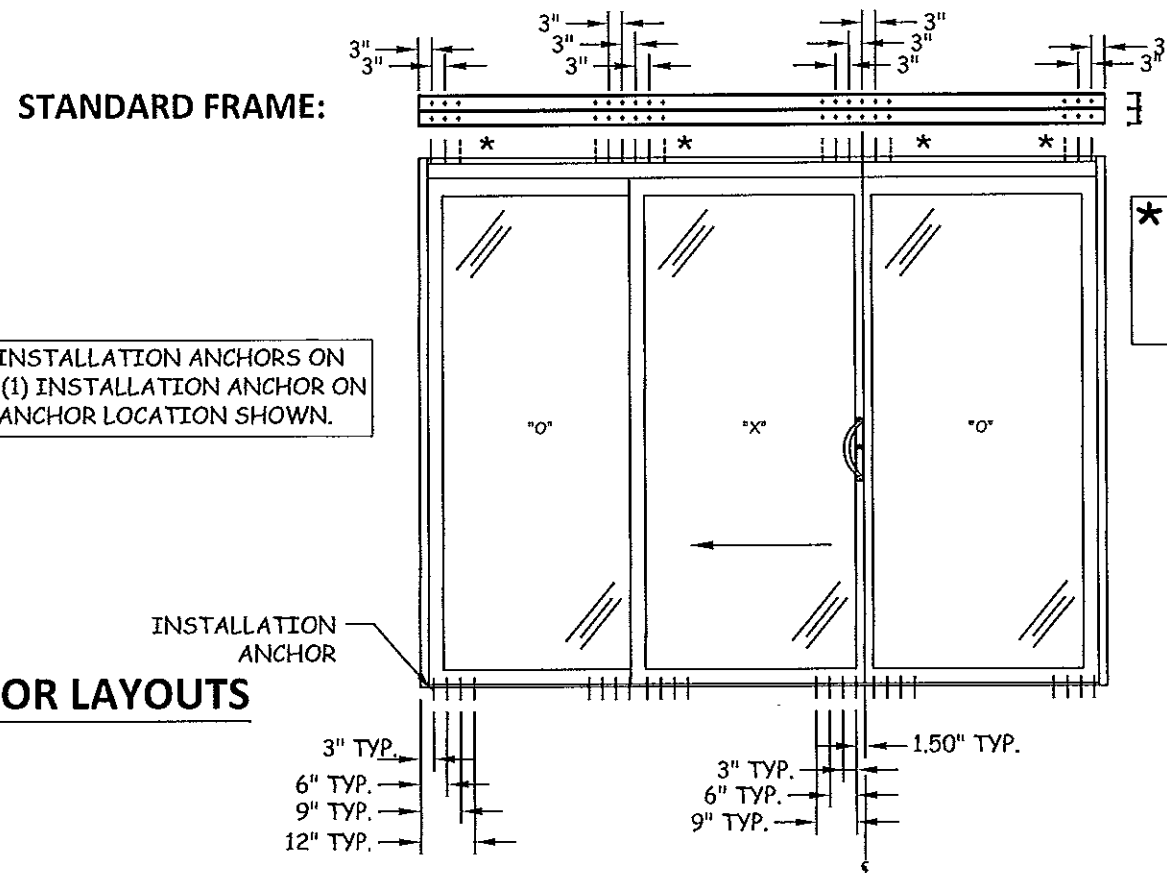

**NOTE: TWO (2) INSTALLATION ANCHORS ON HEAD AND ONE (1) INSTALLATION ANCHOR ON SILL FOR EACH ANCHOR LOCATION SHOWN.**

**\* NOTE: FOR WOOD & STEEL HEAD SUBSTRATE USE SIX (6) ANCHORS AT CORNERS & TWELVE (12) AT INTERLOCKS.**

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 12-0824-08  
Expiration Date 09/22/2015  
By [Signature]  
Miami Dade Product Control



325 W. 74TH PLACE  
HIALEAH, FL 33014  
PH: (305) 231-1101 FX: (305) 231-1103

**TITLE:** SERIES 2000 ALUM.  
SLIDING GLASS DOOR  
ELEVATIONS

PREPARED BY: BUILDING DROPS, INC.  
398 E. DANIA BEACH BLVD. #338  
DANIA BEACH, FL 33004  
PH: 954.399.8478 FX: 954.744.4738

## REVISIONS


NO.	DESCRIPTION	BY	DATE
A	FBC 2010 CODE CHANGE	JLA	07.25.12

DATE:	07.25.12
OWN BY:	JLA
CHK BY:	HFN
SCALE:	NTS


DWG #: CGS009  
SHEET: 2 OF 7

8/20/2012 2:04 PM


s:\projects\continental glass systems\mfg-12-0210 2010 fbc code change (previously done reqs)\dwg\cgs009 fbc 2010.dwg

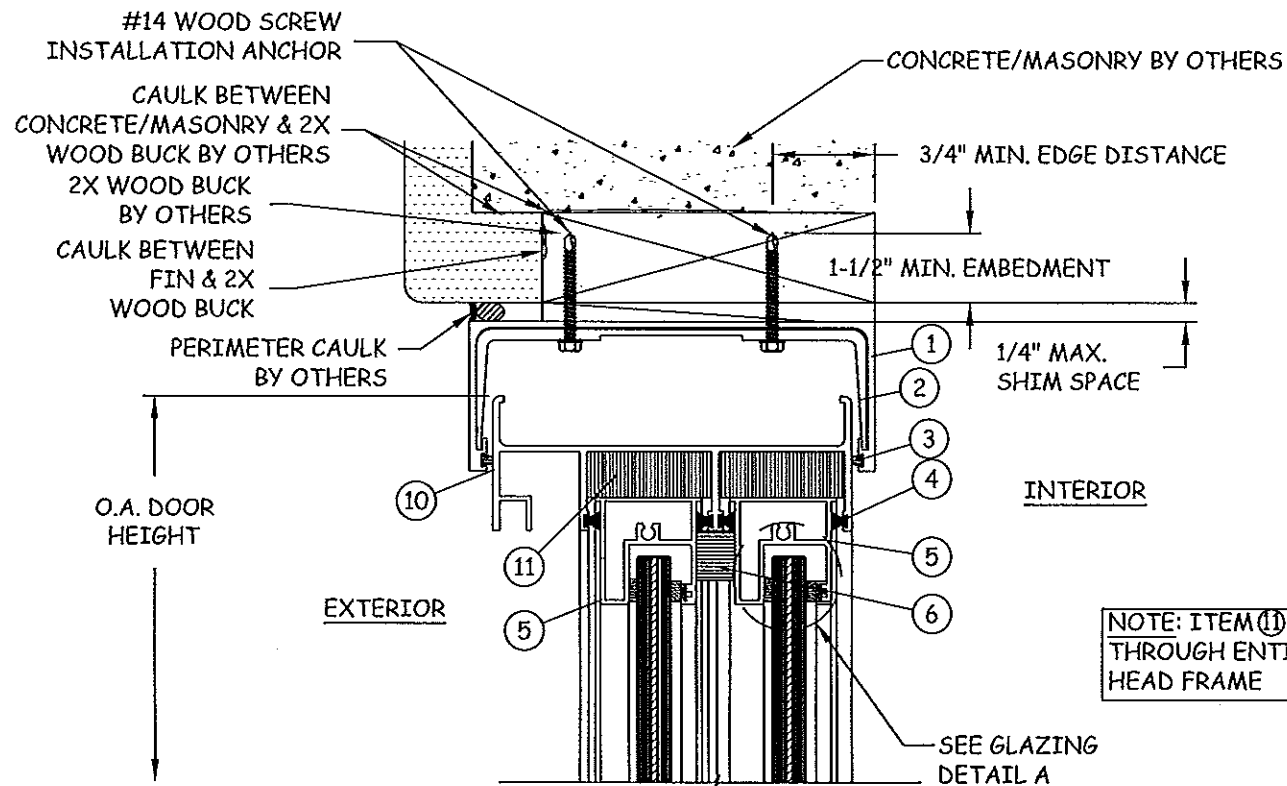


**B**  
**3** VERTICAL SECTION  
REINFORCED HEAD RECEPTOR  
2X WOOD FRAME (SIMILAR ALL SIDES)

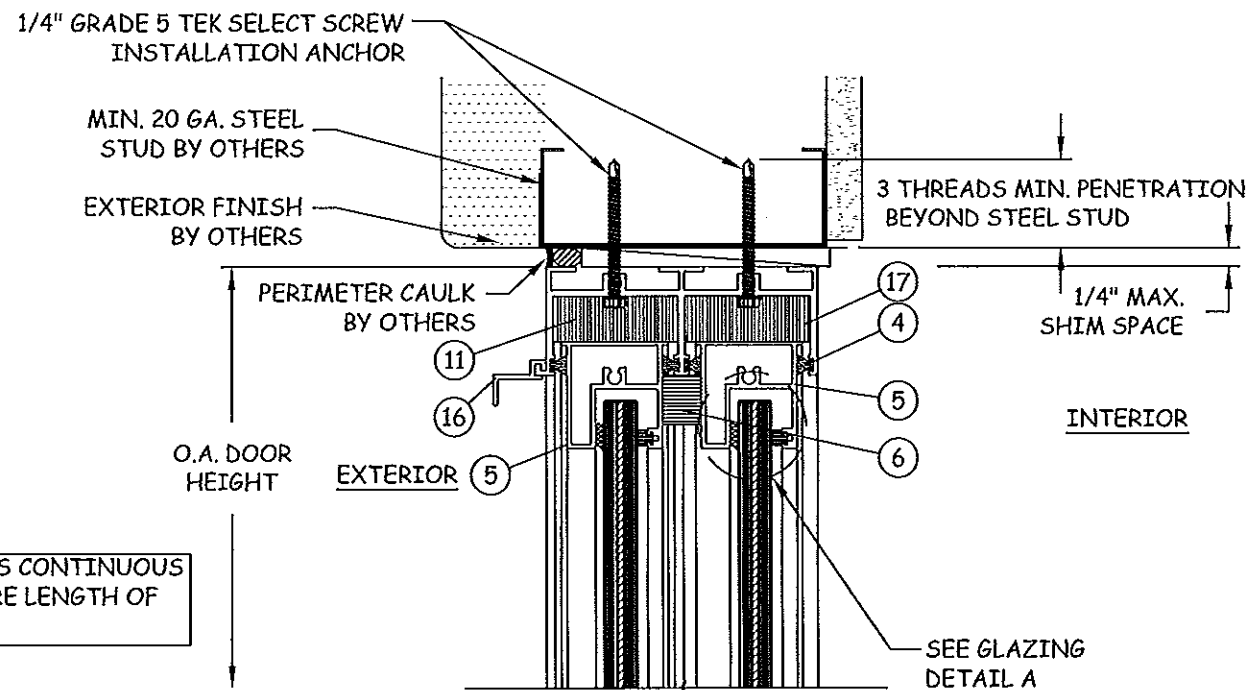

**C**  
**3** VERTICAL SECTION  
STANDARD HEAD  
STEEL STUD (SIMILAR ALL SIDES)

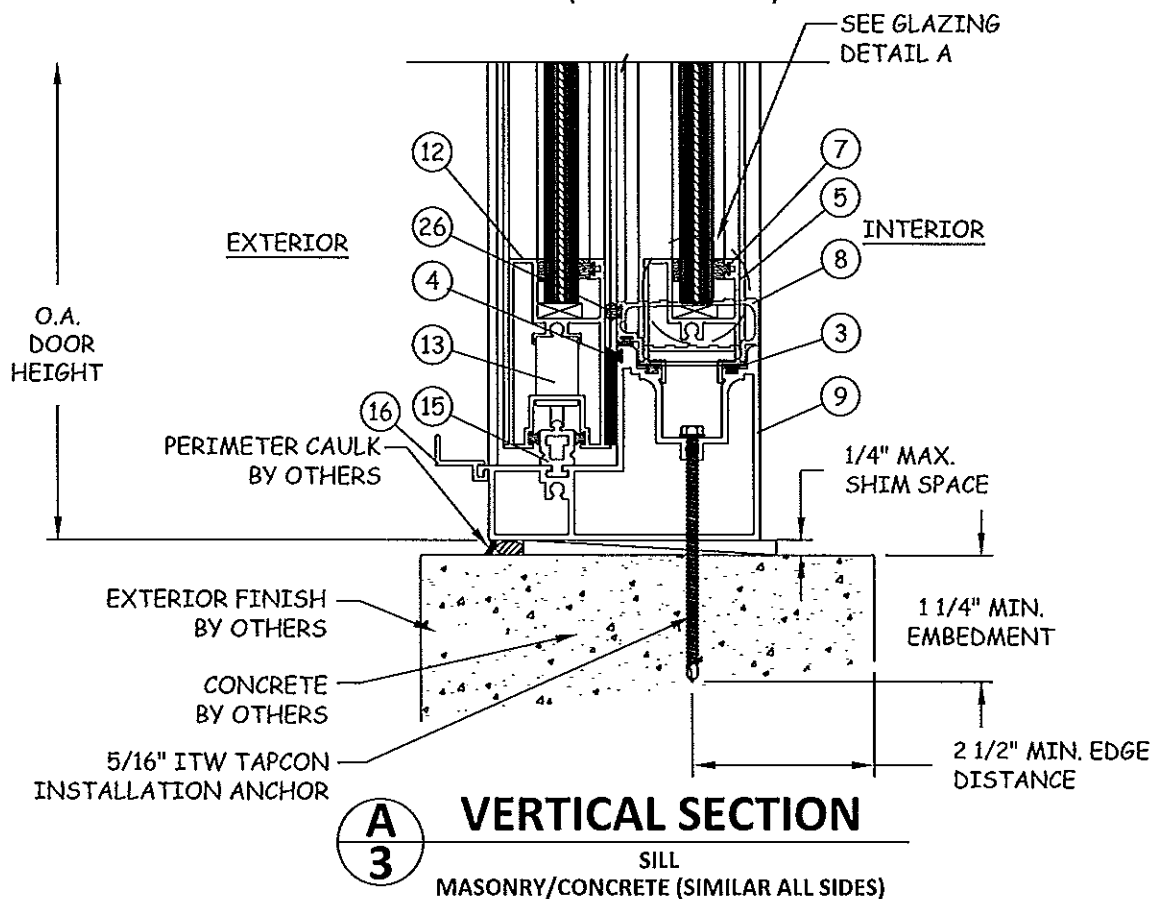

**A**  
**3** VERTICAL SECTION  
SILL  
MASONRY/CONCRETE (SIMILAR ALL SIDES)

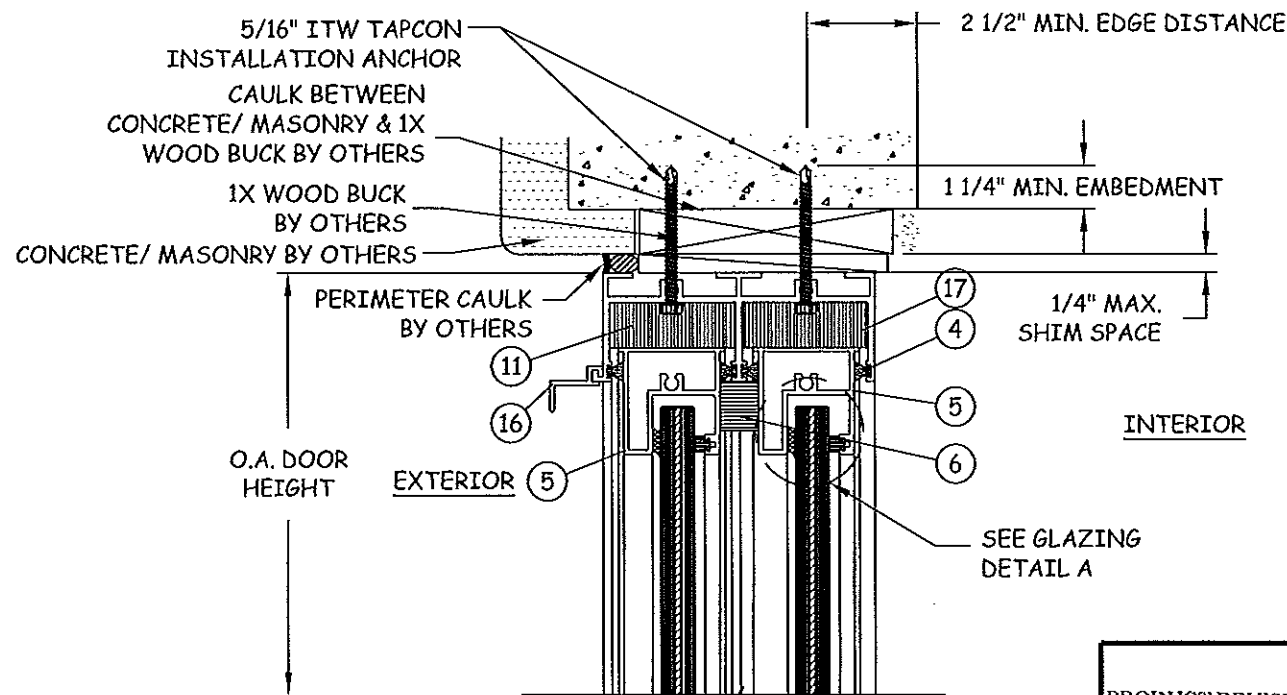

**D**  
**3** VERTICAL SECTION  
STANDARD HEAD  
CONCRETE/MASONRY (SIMILAR ALL SIDES)

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 12-0824-08  
Expiration Date 09/22/2019  
By [Signature]  
Miami Dade Product Control



325 W. 74TH PLACE  
HIALEAH, FL 33014  
PH: (305) 231-1101 FX: (305) 231-1103

TITLE: SERIES 2000 ALUM.  
SLIDING GLASS DOOR  
VERTICAL SECTIONS


PREPARED BY:  
BUILDING DROPS, INC.  
398 E. DANIA BEACH BLVD. #338  
DANIA BEACH, FL 33004  
PH: 954.399.8478 FX: 954.744.4738

## REVISIONS

NO.	DESCRIPTION	BY	DATE
A	FBC 2010 CODE CHANGE	JLA	07.25.12

[Signature]  
HERNAN F. NOBREGA, P.E.  
FLORIDA P. E. NO. 7378  
398 EAST DANIA BEACH BLVD. #338  
DANIA BEACH, FL 33004  
PBPE CERT. OF AUTHORIZATION NO. 29578


DATE:	07.25.12	DWN BY:	JLA	CHK BY:	HFN	SCALE:	NTS
DWG #:	CGS009						
SHEET:	3 OF 7						

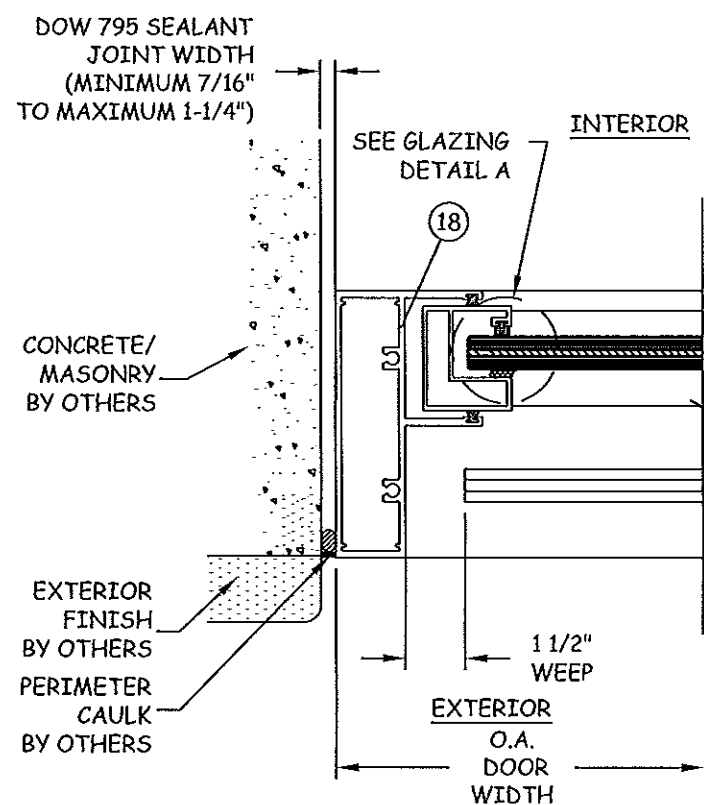


## F 4

# HORIZONTAL SECTION

JAMB - CONCRETE/MASONRY

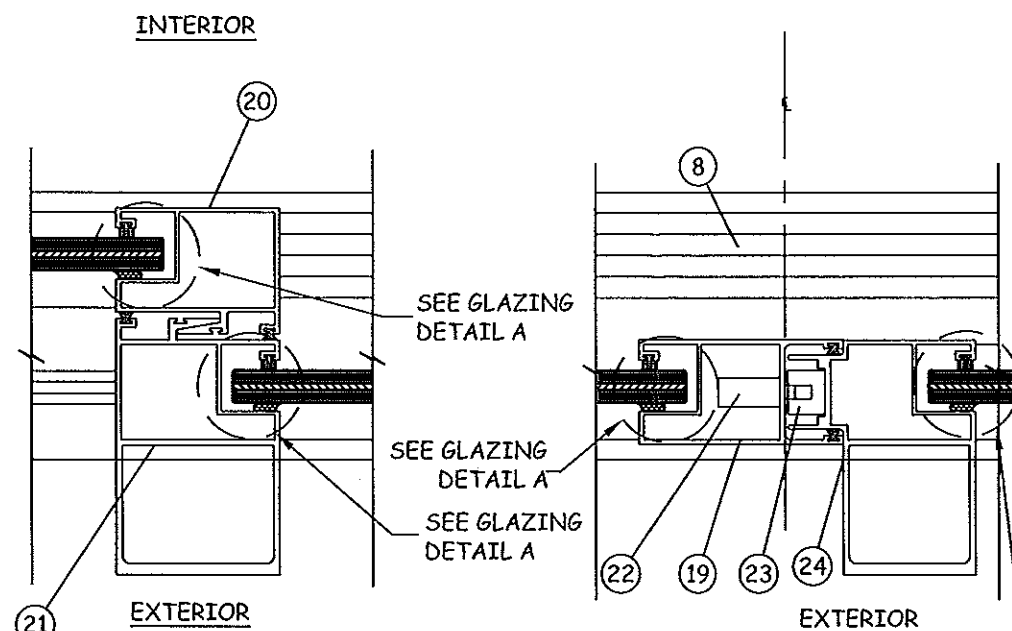

**H**  
**4** **HORIZONTAL SECTION**  
INTERLOCK

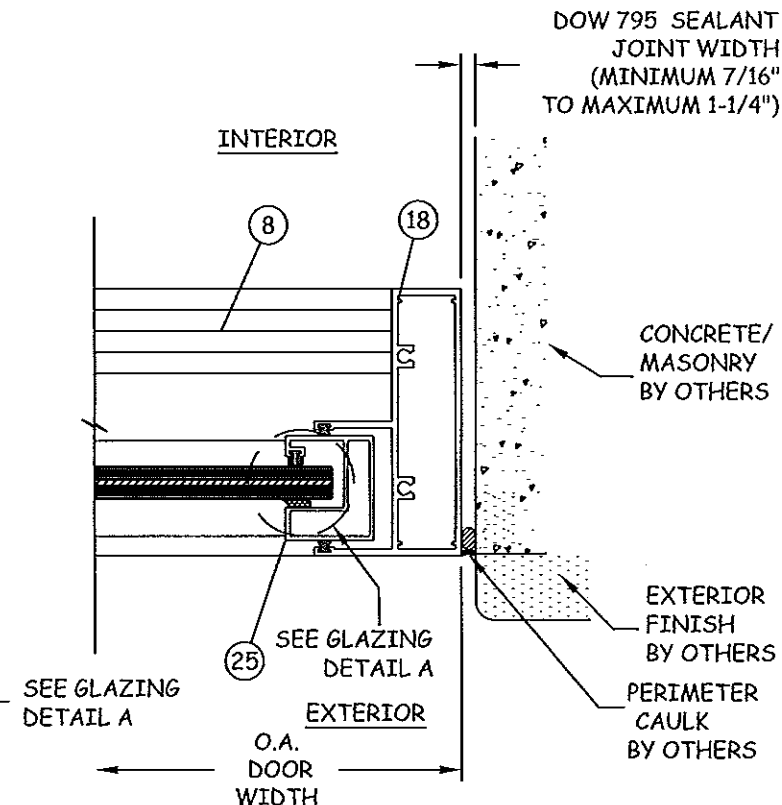


## HORIZONTAL SECTION

JAMB - CONCRETE/MASONRY

NOTES:

1. BACKER ROD DIAMETER EQUALS SEAL WIDTH X 120%
2. SEALANT DEPTH IS 5/8" (-0", +1/16") FOR SEALANT WIDTH UP TO 1-1/4"

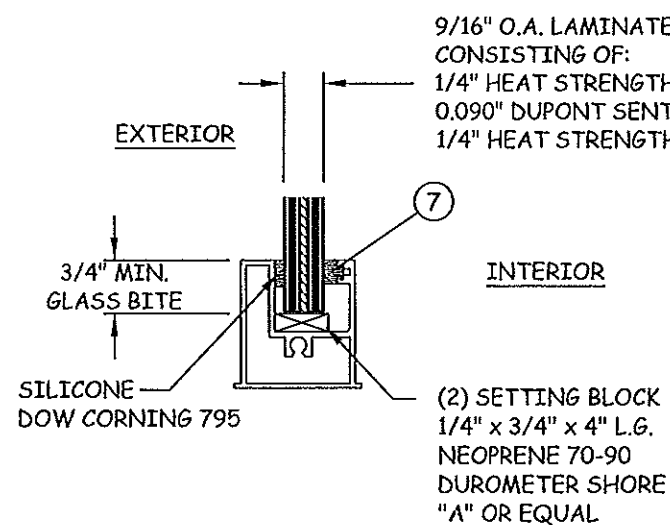

### GLAZING DETAIL A

GLAZING NOTES:

1. DUPONT SENTRYGLAS PLUS INTERLAYER APPROVED UNDER SEPARATE NOA & MEETS FBC 2010 REQUIREMENTS.
2. ALL GLAZING CONFIGURATIONS SHALL COMPLY WITH SAFETY GLAZING REQUIREMENTS OUTLINED IN 2010 FBC SECTION 2406.

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No 12-0824  
Expiration Date 09/22/2015  
By [Signature]  
Miami Dade Product Control


DATE:	07.25.12	DWN BY:	JLA	CHK BY:	HFN	SCALE:	NTS
DWG #: CGS009							
SHEET: 4 OF 7							



325 W. 74TH PLACE  
HIALEAH, FL 33014  
PH: (305) 231-1101 FX: (305) 231-1103

TITLE: SERIES 2000 ALUM.

SLIDING GLASS DOOR  
HORIZONTAL SECTIONS  
& GLAZING DETAIL

PREPARED BY:  BUILDING DROPS, INC.

350 E. DANIA BEACH BLVD. #304  
DANIA BEACH, FL 33004  
PH: 954.399.8478 FX: 954.744.4738

## REVISIONS


NO.	DESCRIPTION	BY	DATE
1	FBC 2010 CODE CHANGE	JLA	07.25.12

HERMES F. NORERO, P.E.  
FLORIDA P. E. NO. 73770  
398 EAST OAKA BEACH BLVD. #338  
- DANIA BEACH, FL 33004


## BILL OF MATERIALS

ITEM NO.	DESCRIPTION	PARTS NUMBERS	MATERIAL	MANUFACTURER
1	HEAD RECEPTOR	2000-07	ALUMINUM 6005-T5	CGS
2	REINFORCING	2000-16	ALUMINUM 6005-T5	CGS
3	VINYL BULB	FP-448-V	PLASTIC	
4	FIN-SEAL .370 X .187		ULTRAFAB	ULTRAFAB
5	TOP & BOTTOM PANEL STILE	2000-08	ALUMINUM 6005-T5	CGS
6	INTERLOCK PAD	P 7509 AFK	ULTRAFAB	ULTRAFAB
7	GLASS SPACING		PLASTIC	
8	THRESHOLD	2000-24	ALUMINUM 6063-T6	CGS
9	SILL	2000-03	ALUMINUM 6005-T5	CGS
10	HEAD	2000-01	ALUMINUM 6005-T5	CGS
11	HEAD PAD	P 10009 AFK	ULTRAFAB	ULTRAFAB
12	BOTTOM MOVING PANEL STILE	2000-09	ALUMINUM 6005-T5	CGS
13	WHEEL	AR-50A		
14	FIN-SEAL .250 X .187		ULTRAFAB	ULTRAFAB
15	SILL TRACK	2000-05	ALUMINUM 6005-T5	CGS
16	SCREEN TRACK	2000-15	ALUMINUM 6005-T5	CGS
17	STANDARD HEAD	2000-02	ALUMINUM 6005-T5	CGS
18	JAMB	2000-04	ALUMINUM 6063-T6	CGS
19	LOCK STILE	2000-10	ALUMINUM 6005-T5	CGS
20	INTERLOCK	2000-11	ALUMINUM 6005-T5	CGS
21	LEFT INTERLOCK	2000-17	ALUMINUM 6005-T5	CGS
22	LOCK	D-60 C		
23	KEEPER	KP-50		
24	HEAVY ASTRAGAL	2000-14	ALUMINUM 6005-T5	CGS
25	FIXED STILE	2000-13	ALUMINUM 6005-T5	CGS
26	Q-LON	U4332		


- 1 HEAD RECEPTOR  
ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .118"

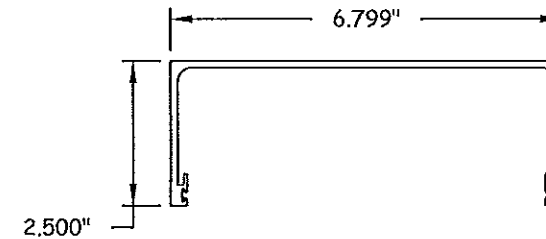


- 2 REINFORCING  
ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .188"

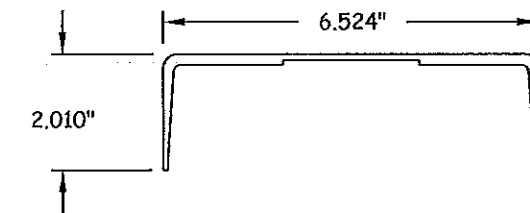

- 5 TOP & BOTTOM PANEL STILE  
ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .075"



- 8 THRESHOLD  
ALUMINUM 6063-T6  
TYPICAL WALL THICKNESS: .075"



325 W. 74TH PLACE  
HIALEAH, FL 33014  
PH: (305) 231-1101 FX: (305) 231-1103

TITLE: SERIES 2000 ALUM.  
SLIDING GLASS DOOR  
COMPONENTS  
& BILL OF MATERIALS

PREPARED BY:  
BUILDING DROPS, INC.  
398 E. DANIA BEACH BLVD. #338  
DANIA BEACH, FL 33004  
PH: 954-399-8478 FX: 954-744-4738

## REVISIONS

NO.	DESCRIPTION	BY	DATE
A	FBC 2010 CODE CHANGE	JLA	07.25.12


HERMES F. NORRERO, P.E.  
FLORIDA P.E. NO. 73778  
398 EAST DANIA BEACH BLVD. #338  
DANIA BEACH, FL 33004  
FBC/CE/12/07/2012

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 12-0824-08  
Expiration Date 09/12/12  
By: [Signature]  
Miami Dade Product Control


DATE: 07.25.12  
DWN BY: JLA  
CHK BY: HFN  
SCALE: NTS  
DWG #: CGS009  
SHEET: 5 OF 7




- 9 SILL  
ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .100"

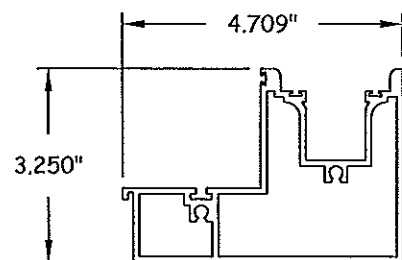


- 10 HEAD  
ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .100"

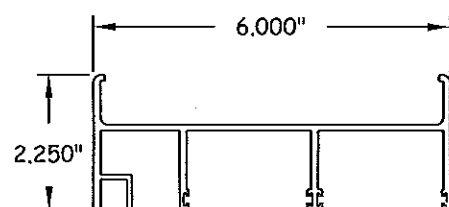


- 12 BOTTOM MOVING PANEL STILE  
ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .075"




- 15 SILLTRACK  
ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .110"

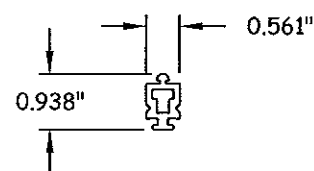


- 16 SCREEN TRACK  
ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .075"

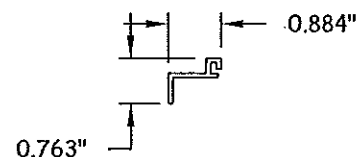


- 17 STANDARD HEAD  
ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .100"

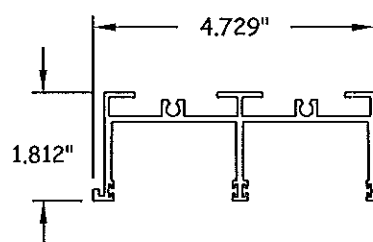


- 18 JAMB  
ALUMINUM 6063-T6  
TYPICAL WALL THICKNESS: .075"

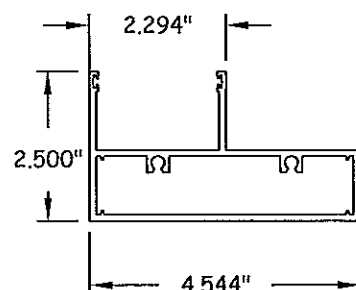


- 19 LOCK STILE  
ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .078"

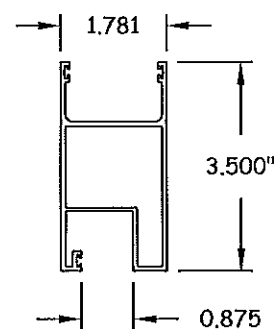


- 20 INTERLOCK  
ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .078"

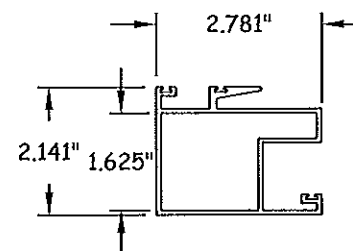


- 21 LEFT INTERLOCK  
ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .078"

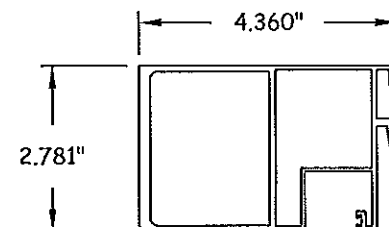

- 24 ASTRAGAL  
ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .078"

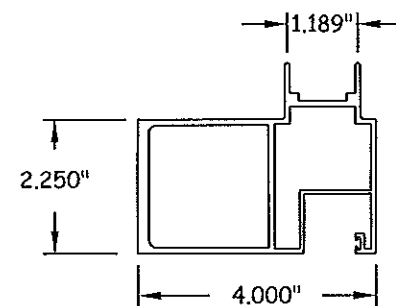

- 25 FIXED STILE  
ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .62"



325 W. 74TH PLACE  
HIALEAH, FL 33014  
PH: (305) 231-1101 FX: (305) 231-1103

TITLE: SERIES 2000 ALUM.  
SLIDING GLASS DOOR  
COMPONENTS

PREPARED BY:  
BUILDING DROPS, INC.  
398 E. DANIA BEACH BLVD. #338  
DANIA BEACH, FL 33004  
PH: 954.399.8478 FX: 954.744.4738

## REVISIONS

NO.	DESCRIPTION	BY	DATE
A	FBC 2010 CODE CHANGE	JLA	07.25.12


HERMES F. MORENO, P.E.  
FLORIDA P. E. NO. 73778  
398 EAST DANIA BEACH BLVD. #338  
DANIA BEACH, FL 33004  
FBPE CERT. # AUTHORIZATION NO. 29378

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 12-082408  
Expiration Date 07/22/2015  
By: [Signature]  
Miami Dade Product Control

DATE: 07.25.12  
DWN BY: JLA  
CHK BY: HFN  
SCALE: NTS  
DWG #: CGS009  
SHEET: 6 OF 7

8/20/2012 2:05 PM


z:\projects\continental glass systems\mtd-12-0210 2010 fbc code change (previously done need)\dwg\cgs009 fbc 2010.dwg

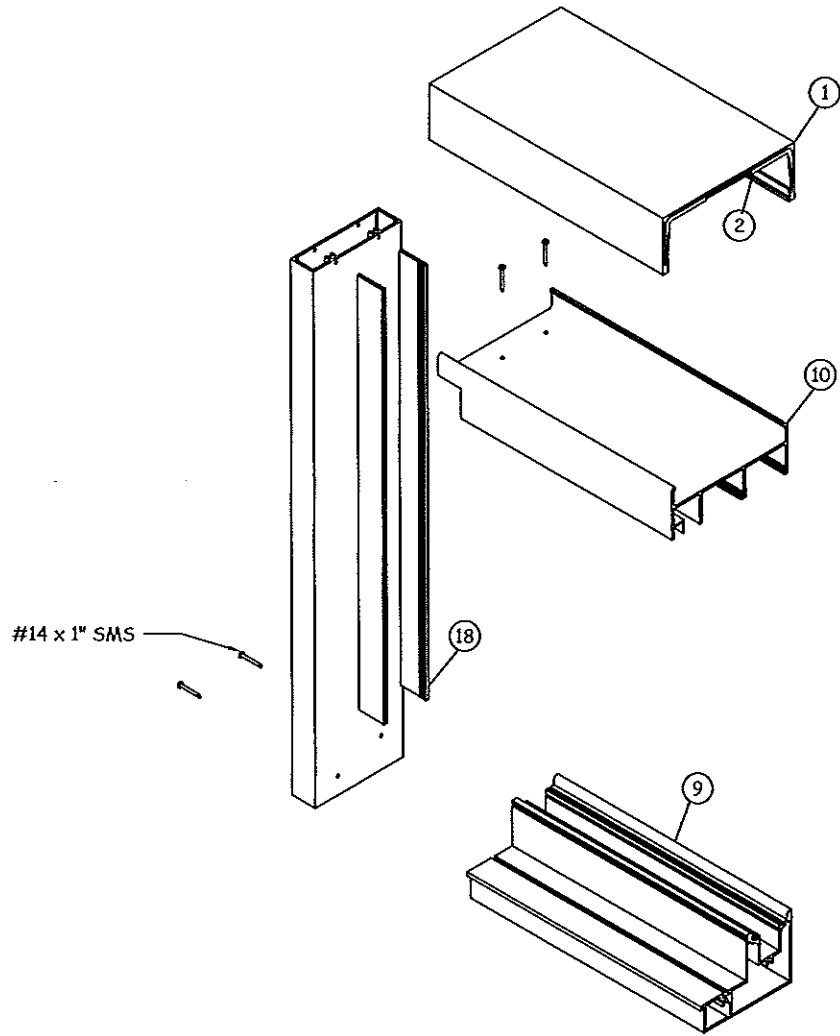

J  
7

### HEAD RECEPTOR


HEAD ASSEMBLY  
FRAME CONSTRUCTION

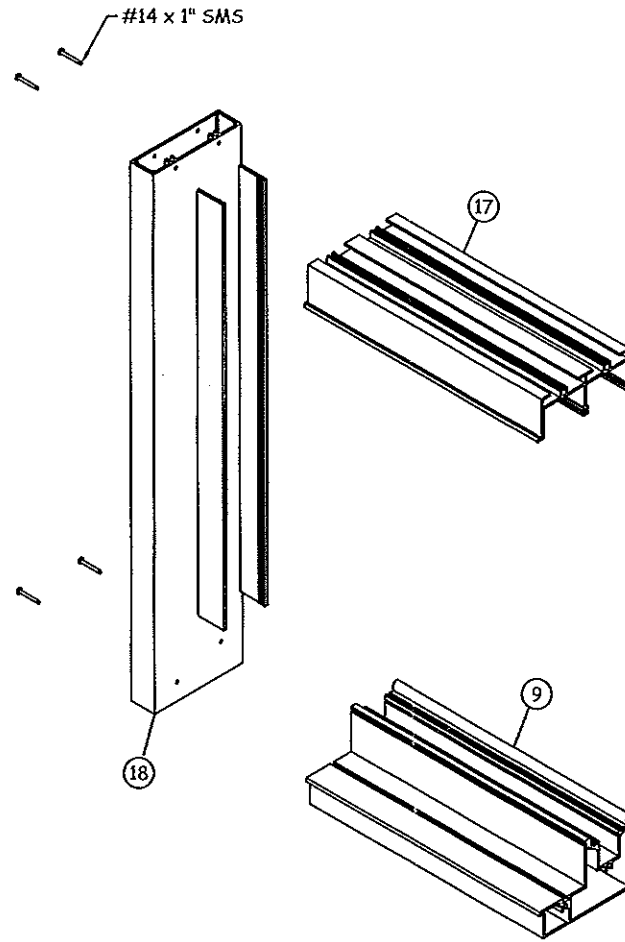

K  
7

### STANDARD FRAME

HEAD & SILL ASSEMBLY  
FRAME CONSTRUCTION

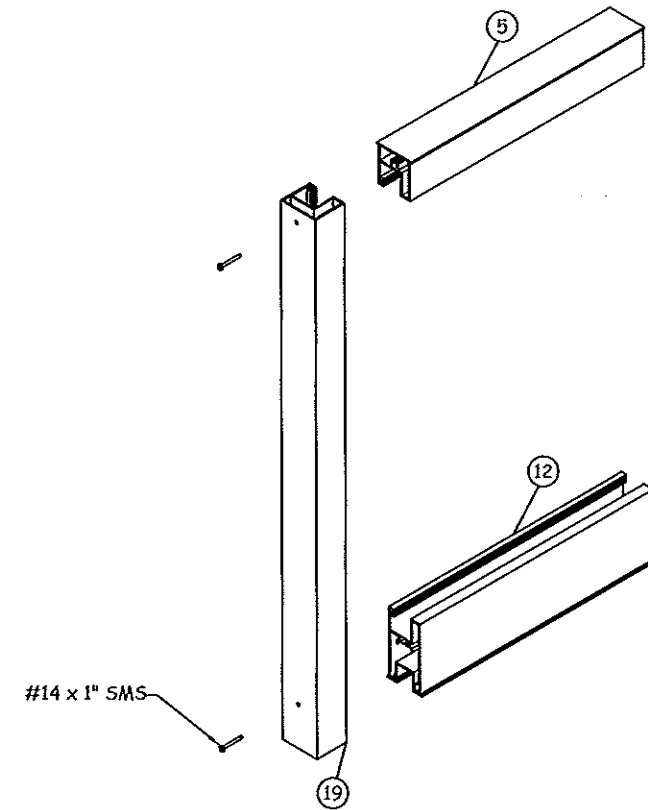

L  
7

### DOOR PANEL

TOP & BOTTOM CORNERS  
PANEL CONSTRUCTION

PRODUCT REVISED  
is complying with the Florida  
Building Code  
Acceptance No. 12-0824-03  
Expiration Date 09/23/2015  
By: [Signature]  
Miami Dade Product Control

DATE: 07.25.12  
DWN BY: JLA  
CHK BY: HFN  
SCALE: NTS  
DWG #: CGS009  
SHEET: 7 OF 7



325 W. 74TH PLACE  
HIALEAH, FL 33014  
PH: (305) 231-1101 FX: (305) 231-1103

TITLE: SERIES 2000 ALUM.  
SLIDING GLASS DOOR  
CORNER ASSEMBLY  
PREPARED BY:  
BUILDING DROPS, INC.  
398 E. DANIA BEACH BLVD. #338  
DANIA BEACH, FL 33004  
PH: 954-399-8478 FX: 954-744-4736

REVISIONS			
NO.	DESCRIPTION	BY	DATE
A	FBC 2010 CODE CHANGE	JLA	07.25.12

HERMES F. NOKRO, P.E.  
FLORIDA P.E. NO. 75578  
398 E. DANIA BEACH BLVD. #338  
DANIA BEACH, FL 33004  
FBPE CERT. OF AUTHORIZATION NO. 29578